




SINGLE SKEET LAUNCHER PRE-WIRED FOR USE WITH EXISTING 110 VAC. RELEASE SYSTEM

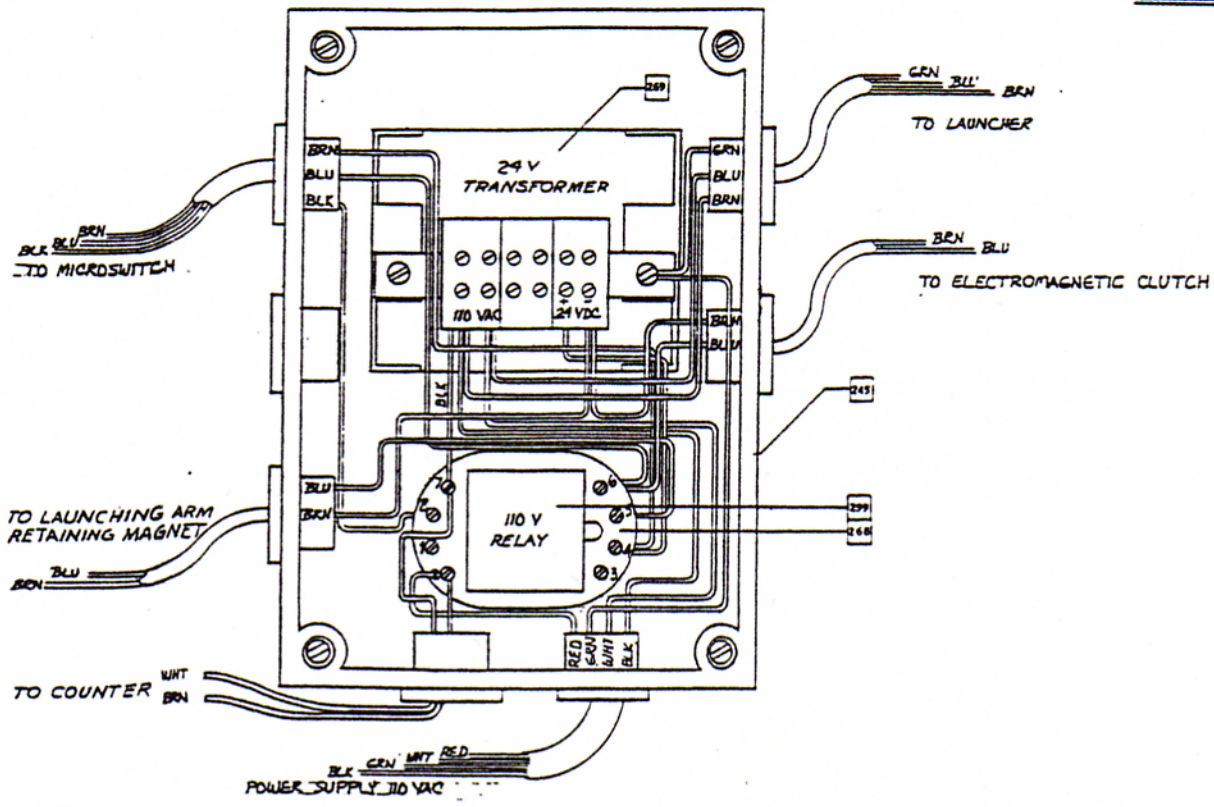


110 VAC - ON-OFF-RELEASE (SKEET)

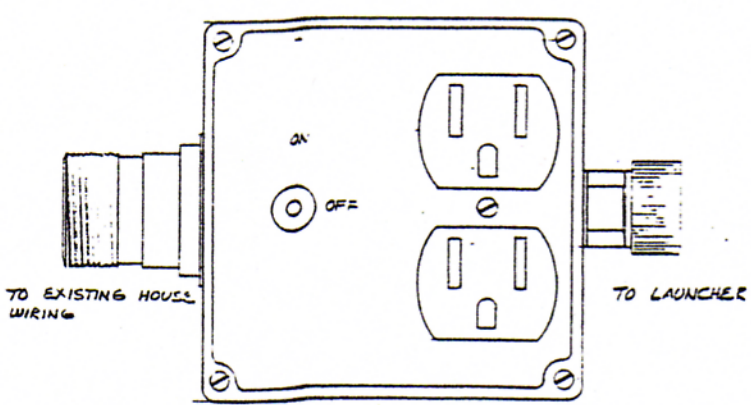

This should be where you LINES come from

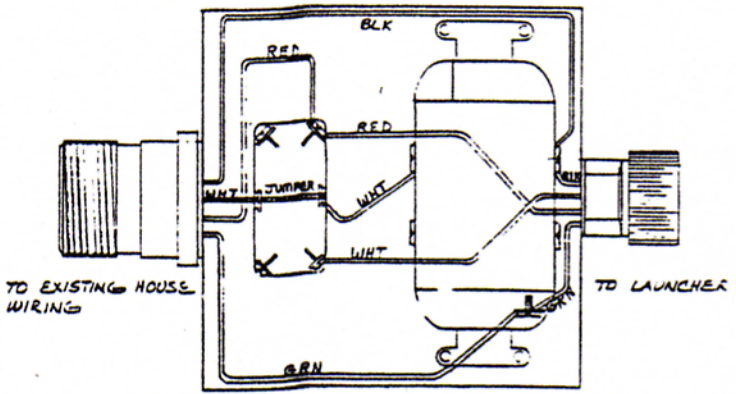


110 VAC. TIMER (SKEET)

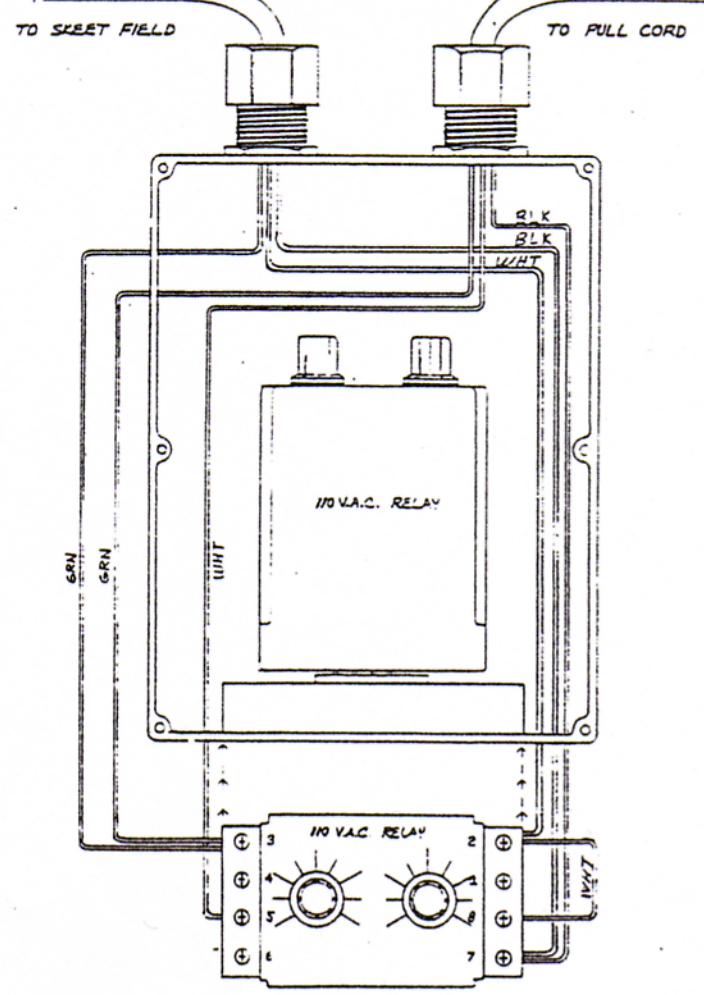

Wiring Diagram Fig. 13

For 1574

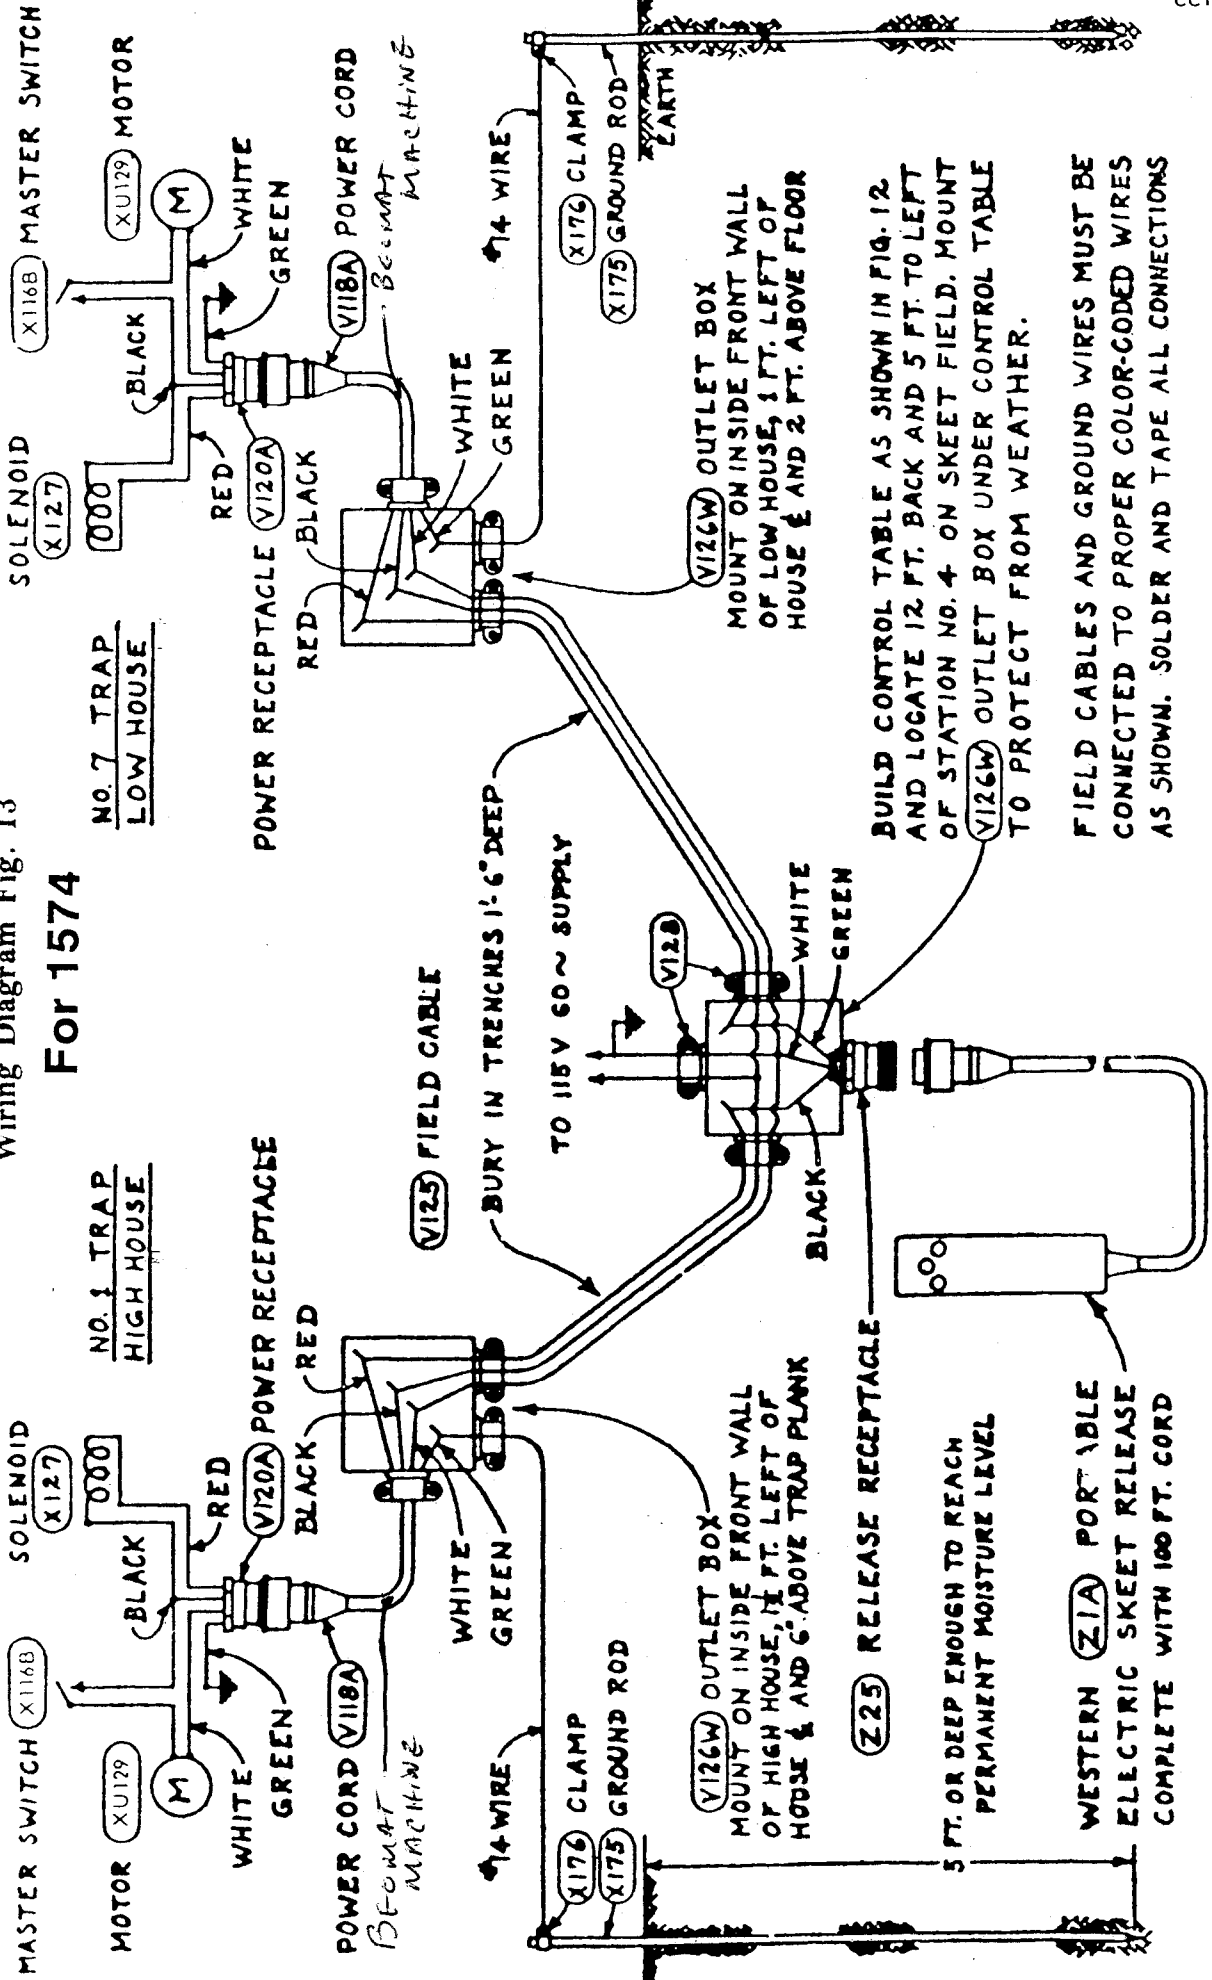

BUILD CONTROL TABLE AS SHOWN IN FIG. 12 AND LOCATE 12 FT. BACK AND 5 FT. TO LEFT OF STATION NO. 4 ON SKEET FIELD. MOUNT (V126W) OUTLET BOX UNDER CONTROL TABLE TO PROTECT FROM WEATHER.

FIELD CABLES AND GROUND WIRES MUST BE CONNECTED TO PROPER COLOR-CODED WIRES AS SHOWN. SOLDER AND TAPE ALL CONNECTIONS

WARNING - Electrical installations must be made in accordance with National Electrical Code and applicable local codes!